


NOTES

1. This layout shown for attenuation pond or basin to be laid to the basin profile. (This type of headwall can be used as a straight and vertical retaining feature).
2. Natural vegetated headwall is to be built as per the manufacturer's specification.
3. Headwall to be treated with hydroseeding or live planting.
4. The first pipe joint shall be flexible and located not more than 300mm from the back of the headwall.
5. Distance between the edge of headwall and footway/carrageway to be 1m minimum.
6. For pipes 450mm dia. and above, a hinge coupling grating is required.
7. Liaison with LLFA and LPA required.



SECTION

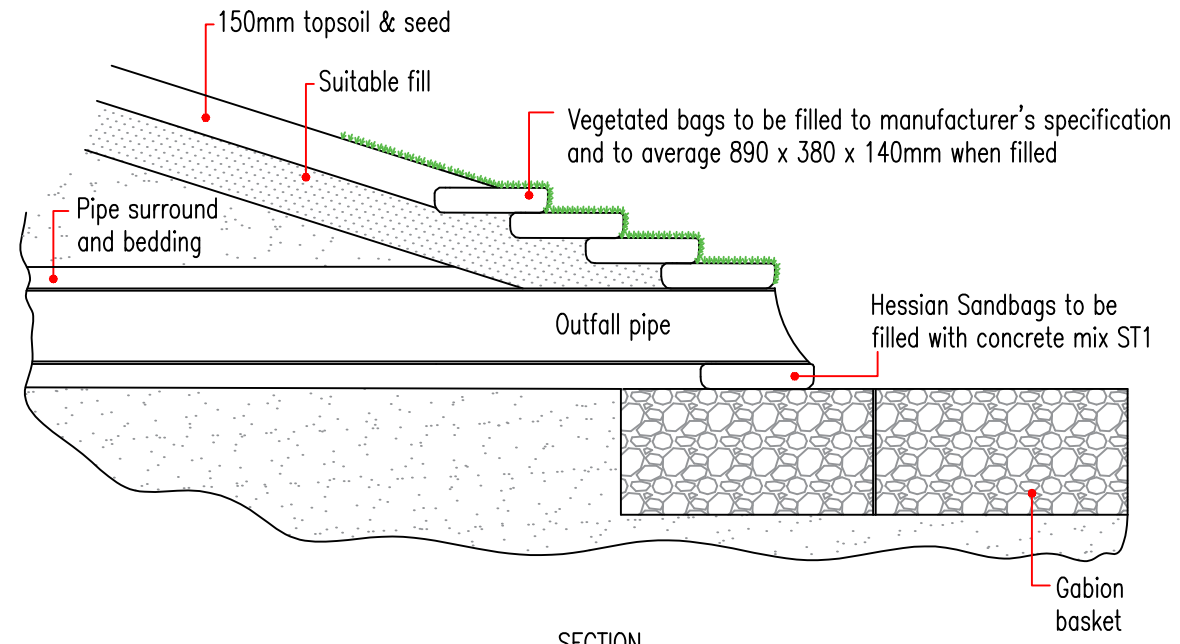

Growth, Highways & Infrastructure
Suffolk County Council
Endeavour House
8 Russell Road
Ipswich
Suffolk IP1 2BX

DRAWING TITLE

DRAINAGE AND SERVICE DUCTS
NATURAL VEGETATED HEADWALL

REV.	DESCRIPTION	CHECKED	DATE

ORIGINATOR	RY	08/2024	PROJECT TITLE STANDARD CONSTRUCTION DETAILS	
CHECKER	SH	08/2024	SCALE	DATE
DESIGNER	RY	08/2024	N.T.S.	AUG. 2024
REVIEWER	TK	08/2024	DRAWING No. DM-500-13	